



IMPORTANT :-
 THE GROUP CONTROLLER'S POWER SUPPLIES COOLING RELIES ON NATURAL CONVECTION THROUGH THE CASE LOUVRES FOR CORRECT OPERATION THE POWER SUPPLY MUST BE MOUNTED AS SHOWN IN THIS INSTRUCTION, ALLOWING A MINIMUM FREE AIR CLEARANCE AROUND THE CASE OF 50mm

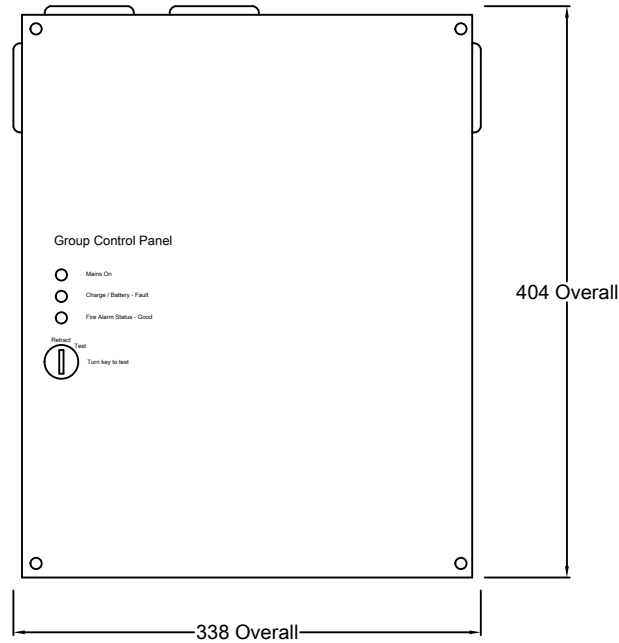

LID SECURED
 BY 4 NO. SCREWS

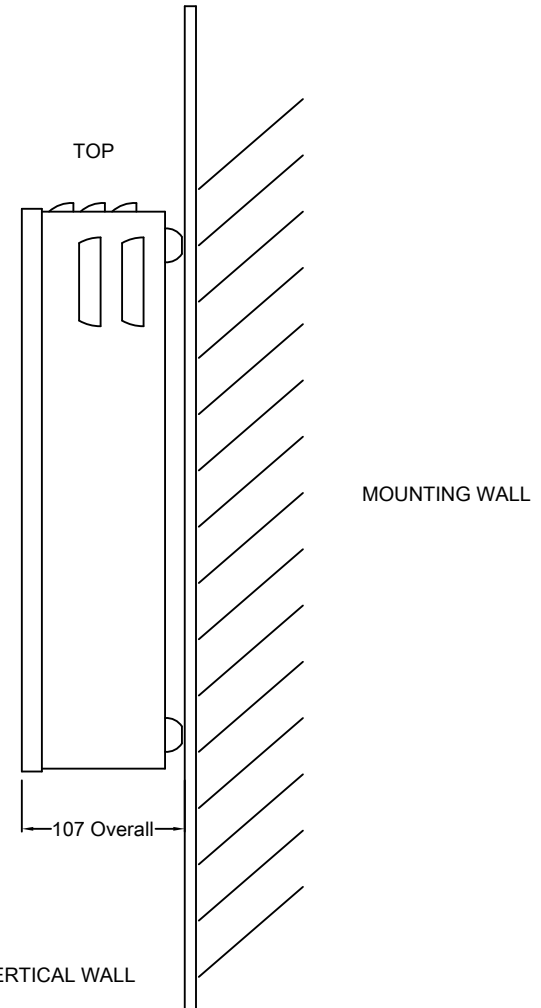

MOUNT ON VERTICAL WALL

COLOUR : APPLIANCE WHITE
 WEIGHT : (INCLUDING BATTERIES) 12 kg

REV A :-	REV B :-	REV C :-	REV D :-	REV E :-
DATE :-	DATE :-	DATE :-	DATE :-	DATE :-

DRAWN BY	D. NAYLOR
DATE	2 / 08 / 11
CHECKED BY	
DATE	
DISC NO.	
ALL DIMENSIONS IN MILLIMETRES UNLESS STATED OTHERWISE. DO NOT SCALE. IF IN DOUBT ASK.	

PROJECT	Standard Drawings
TITLE	GCP88-3 Cabinet Details
DRAWING NUMBER	BLE-201

 MAKING BUILDINGS SAFER B.L.E. SMOKE & FIRE CURTAINS HEAD OFFICE SHEFFIELD TEL :- 0114 251 4703 FAX :- 0114 251 3908 email:- curtains@blegroup.co.uk	SMOKE CURTAINS
	FIRE CURTAINS
	FIXED CURTAINS
	INSTALLATION COMMISSIONING